


# LIQUID LEVEL ALARM

DELUXE VERSION - HIGH AND LOW LEVEL

FPC-12664

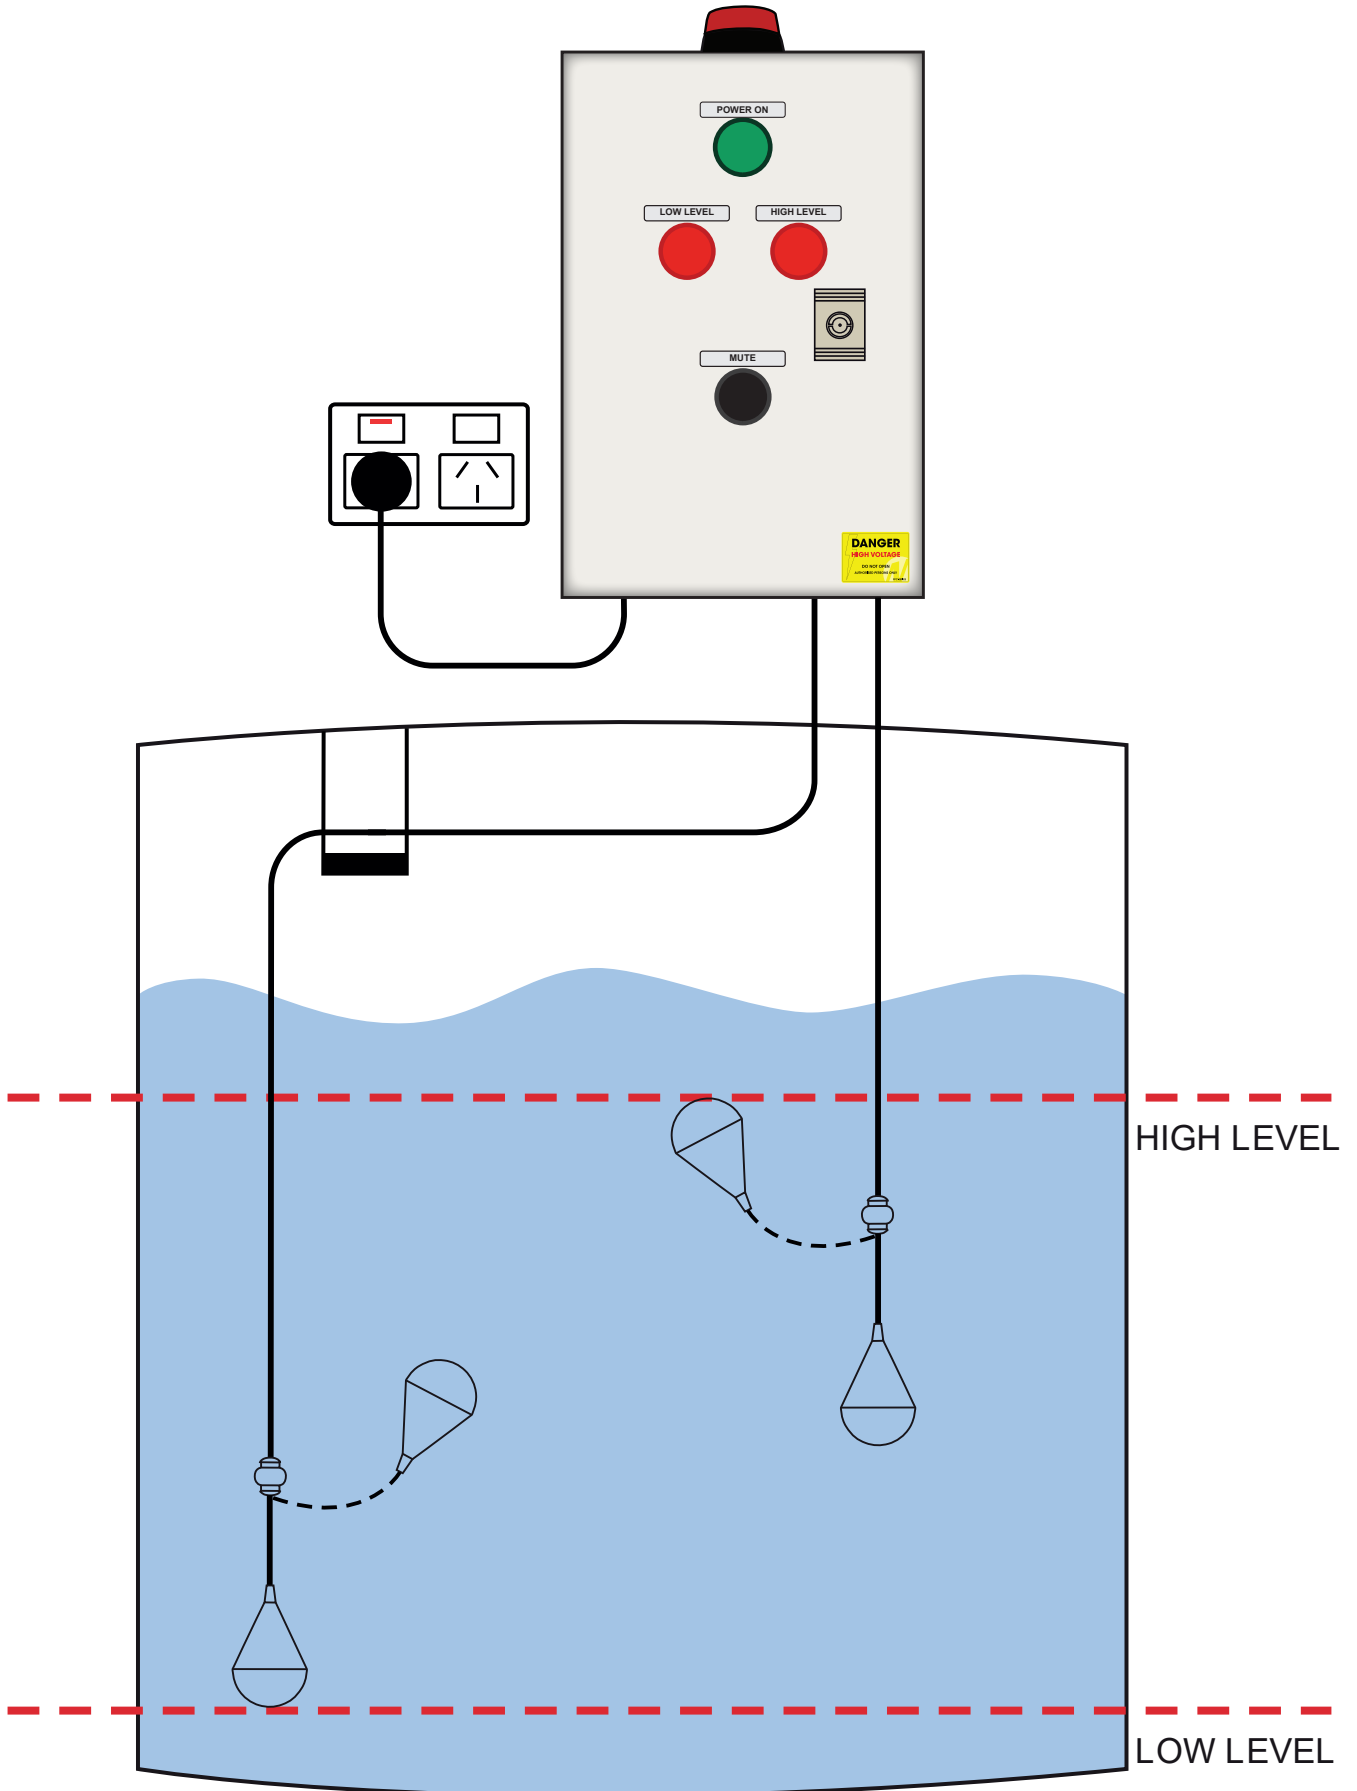

# LIQUID LEVEL ALARM

DELUXE VERSION - HIGH AND LOW LEVEL

FPC-12664



## Features

- Designed to provide warning indication when storage (Effluent, Grey Water, Rain Water etc) tank is both empty or full.
- Warning condition determined by a Float Switch
- Warning Alarms are: Audio - Buzzer  
Visual - LED Pilot Light
- The buzzer can be muted via the mute button. The visual alarms will remain on until the alarm condition is eradicated.
- If not muted the audible buzzer will automatically silence after 5 minutes. If a continuously sounding audible alarm is required, this can be done by changing the Jumper position (see Figure 1).
- Controller can be installed up to 50m from the tank being monitored. Float Switch cabling is 'safe', low voltage circuitry

NOTE: Float Switch not included - optional extra

Controller must be installed by a suitably qualified Electrician

## Wiring Diagram

